


THE SPECIFICATION OF CHEMICAL CORROSION RESISTANT FRP TANK

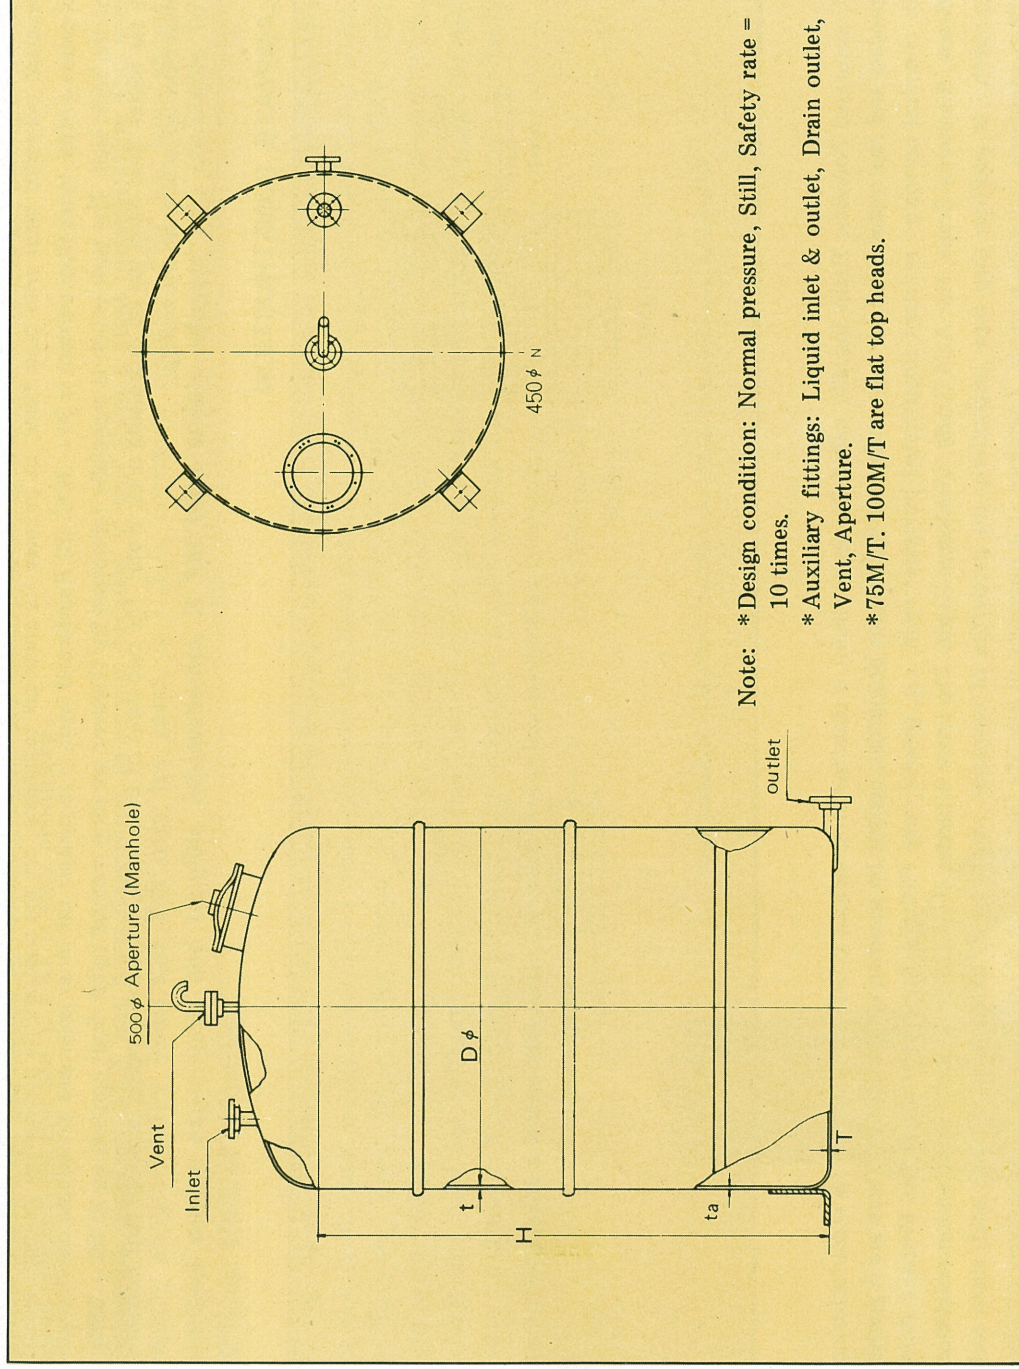

VOLUME m ³	INNER DIAMETER (D φ)	HEIGHT (H)	THICKNESS OF UPPER TANK WALL (t)	THICKNESS OF LOWER TANK WALL (ta)	BOTTOM THICKNESS (T)
10	2000	3200	5	6	6
15	2500	3100	5	6	7
20	2500	4100	6	7	7
30	3000	4250	6	8	8
40	3000	5700	6	9	10
50	3400	5550	6	10	12
60	3400	6650	6	11	13
75	3800	6650	7	11	14
100	3800	8850	8	12	14
120	3800	10600	8	12	14